



# Desalination Engineering Feasibility Study-Update

Santa Clara Valley Water District

Environmental and Water Resources Committee

January 26, 2026

# Agenda

- Overview
- Fatal Flaw Analysis Results
  - Subsurface Intakes
  - Screened Surface Intakes
  - Siting Facility
  - Brine Management
- Alternatives Analysis
- Next Steps


2

# Study Overview & Approach

# Fatal Flaw Analysis Components

4

- **Intakes**
  - Subsurface
  - Screened surface intake
    - Type, location, and screen options
- **Facility Siting**
  - Several sites analyzed
- **Brine Management**
  - Comingling brine with treated wastewater
  - New deep outfall with diffusers
  - Horizontal levees
  - Cargill use

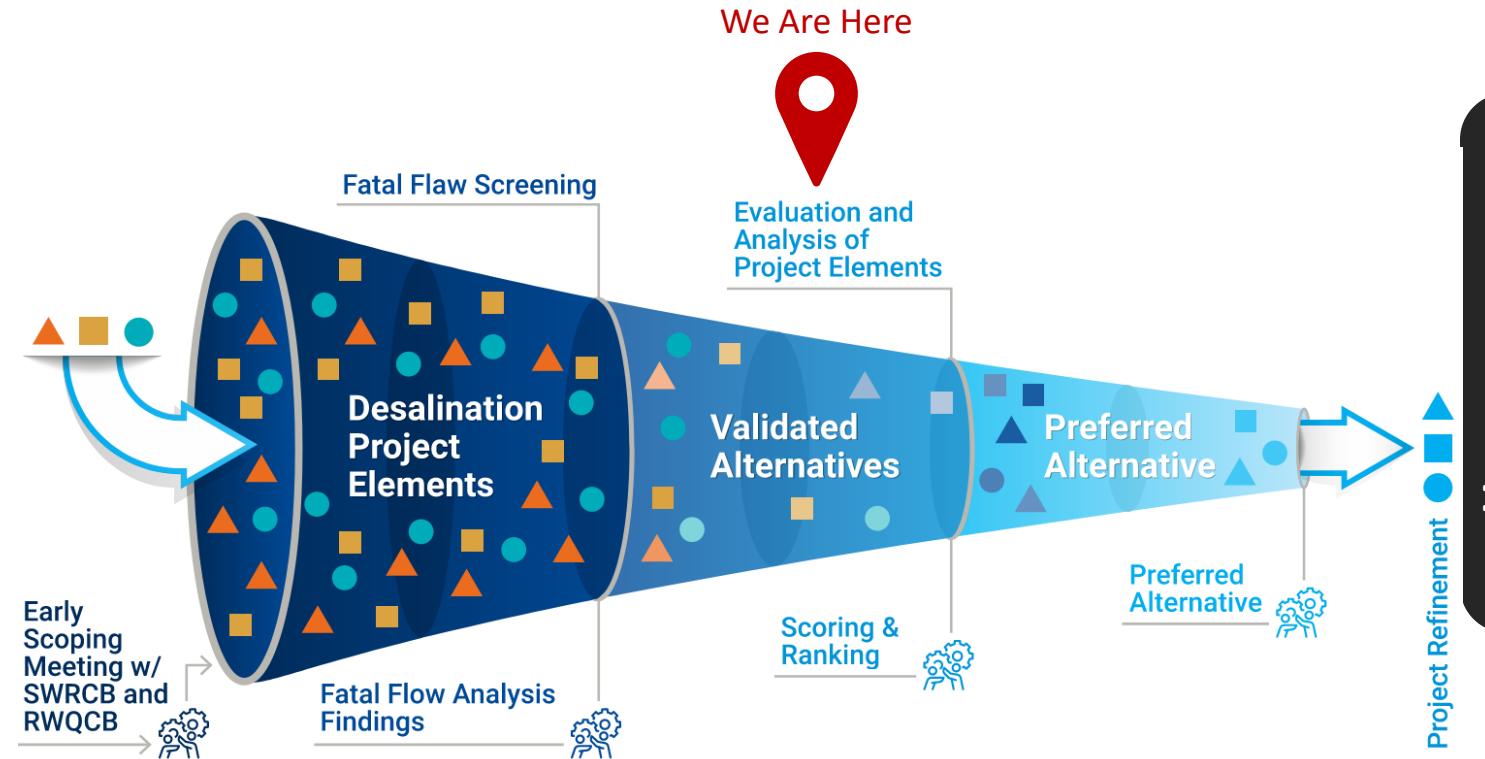


# Fatal Flaw Analysis Results

# Subsurface Intake Wells

## Preliminary Findings




- Shallow aquifer near the Bay has thin, discontinuous water pockets
- No direct lateral connection to the Bay.
- A minimum demand of ~20 MGD would require **~700 wells**
- Require to acquire large areas of land

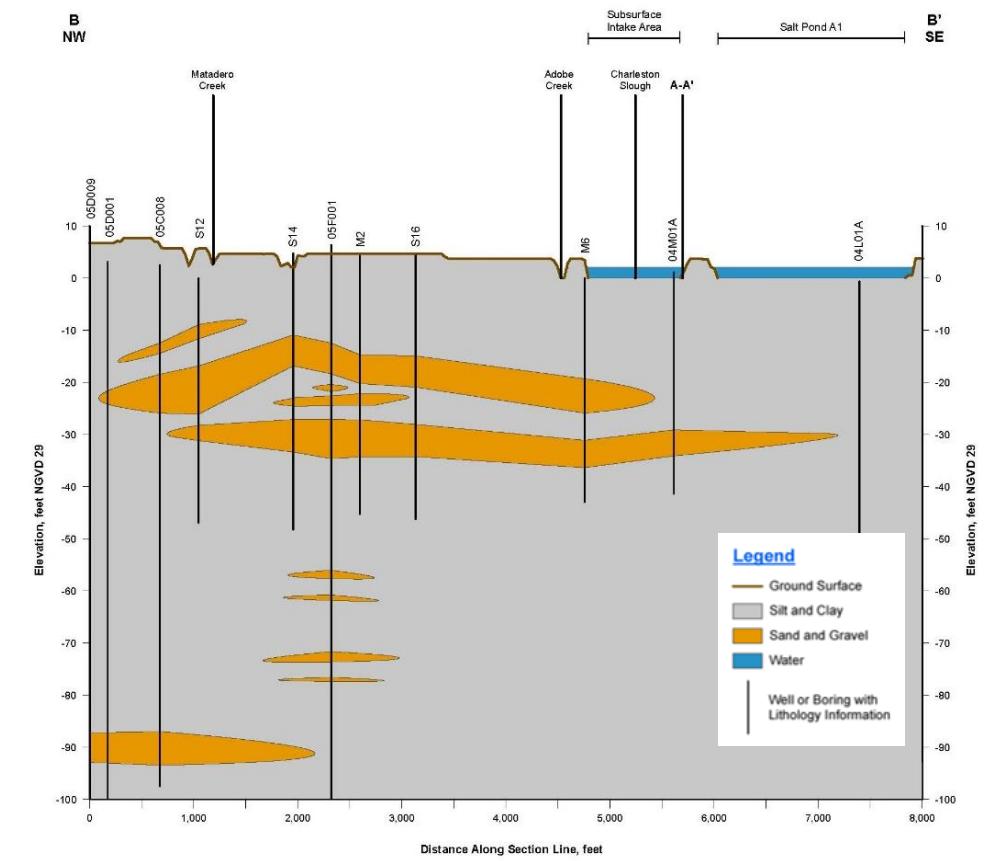

# Subsurface Intake Wells


## Basis for Findings

- Extensive history of groundwater basin
- Ongoing and comprehensive monitoring and reporting
  - Annual groundwater reports
  - Sustainable Groundwater Management Act (SGMA)
  - Special studies related to seawater level rise and potential impacts

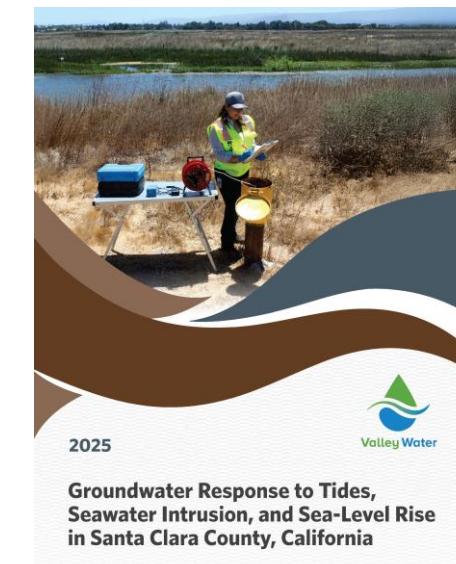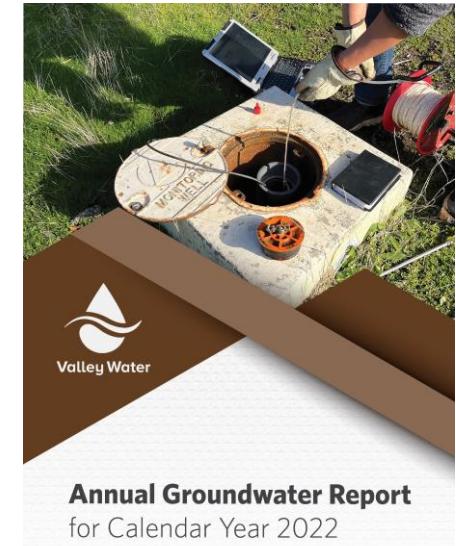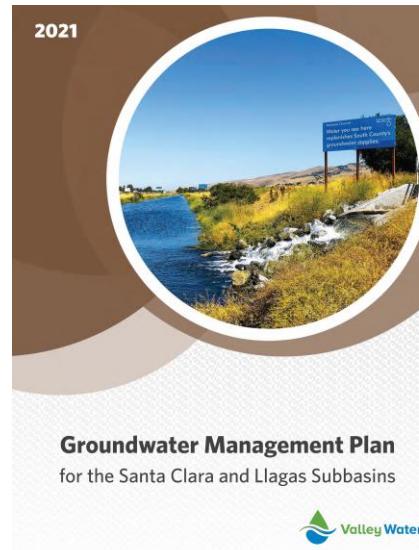


# Intake Alternatives

## Submerged Offshore

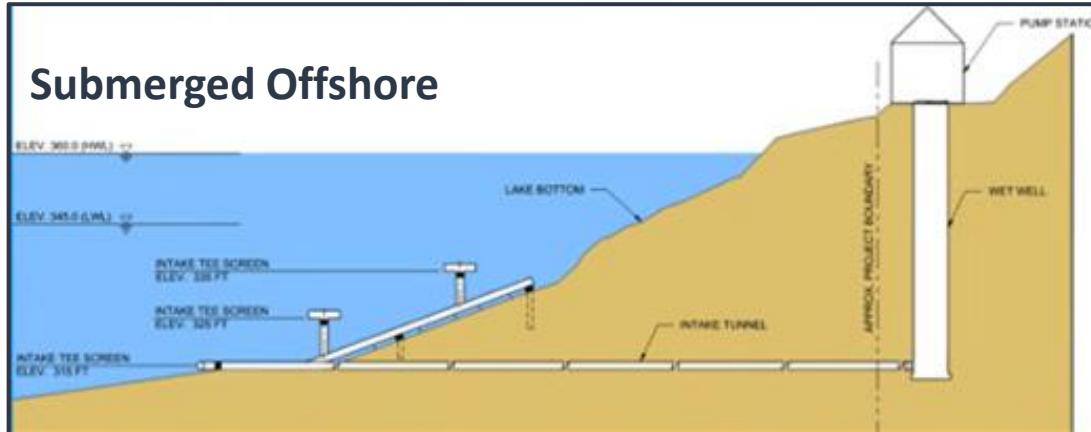


## On Bank/Near Shore

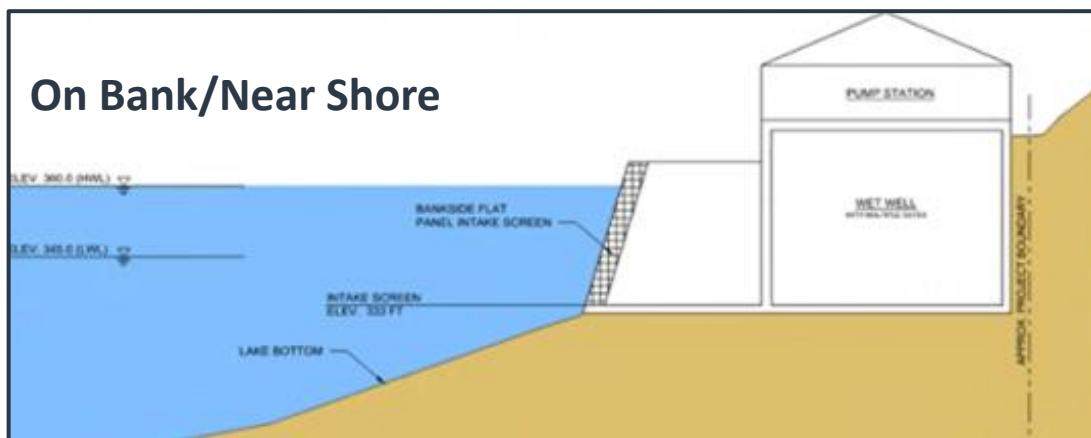

## Intake Types

## Intake Locations

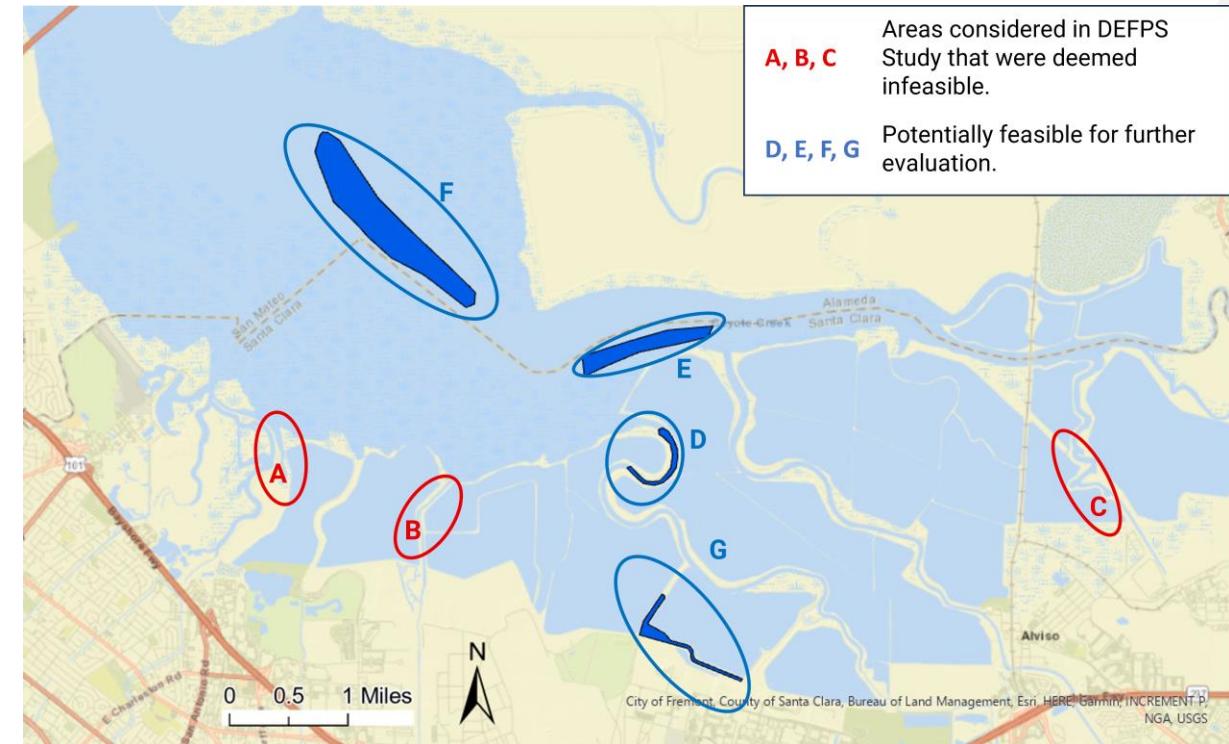

## Conical Screen



## Cylindrical Screen



## Hemispherical Screen



## Screen Options

N

9

# Facility Siting: 12 Locations Evaluated



Local WWTP



Preferred Site



Potentially Infeasible Site



Other Site

# Brine Management

## Options Evaluated

- Comingling with Treated Wastewater Effluent from Existing WWTP
- New deep Bay Outfall with Brine Diffuser
- Horizontal Levee
- Cargill Salt



# Fatal Flaw Analysis Summary

11

## • Intakes

- Subsurface – infeasible
- Screened surface intake
  - 3 locations potentially feasible
  - 3 screen types (conical, cylindrical, and hemispherical)

## • Facility Siting

- Multiple sites analyzed
  - 3 sites potentially feasible

## • Brine Management

- Comingling brine with treated wastewater
- New Deep outfall with diffusers
- Horizontal levees – infeasible
- Cargill use – infeasible




# Alternatives Analysis

# Alternatives Analysis

13

## Summary Approach to Alternative Development and Screening

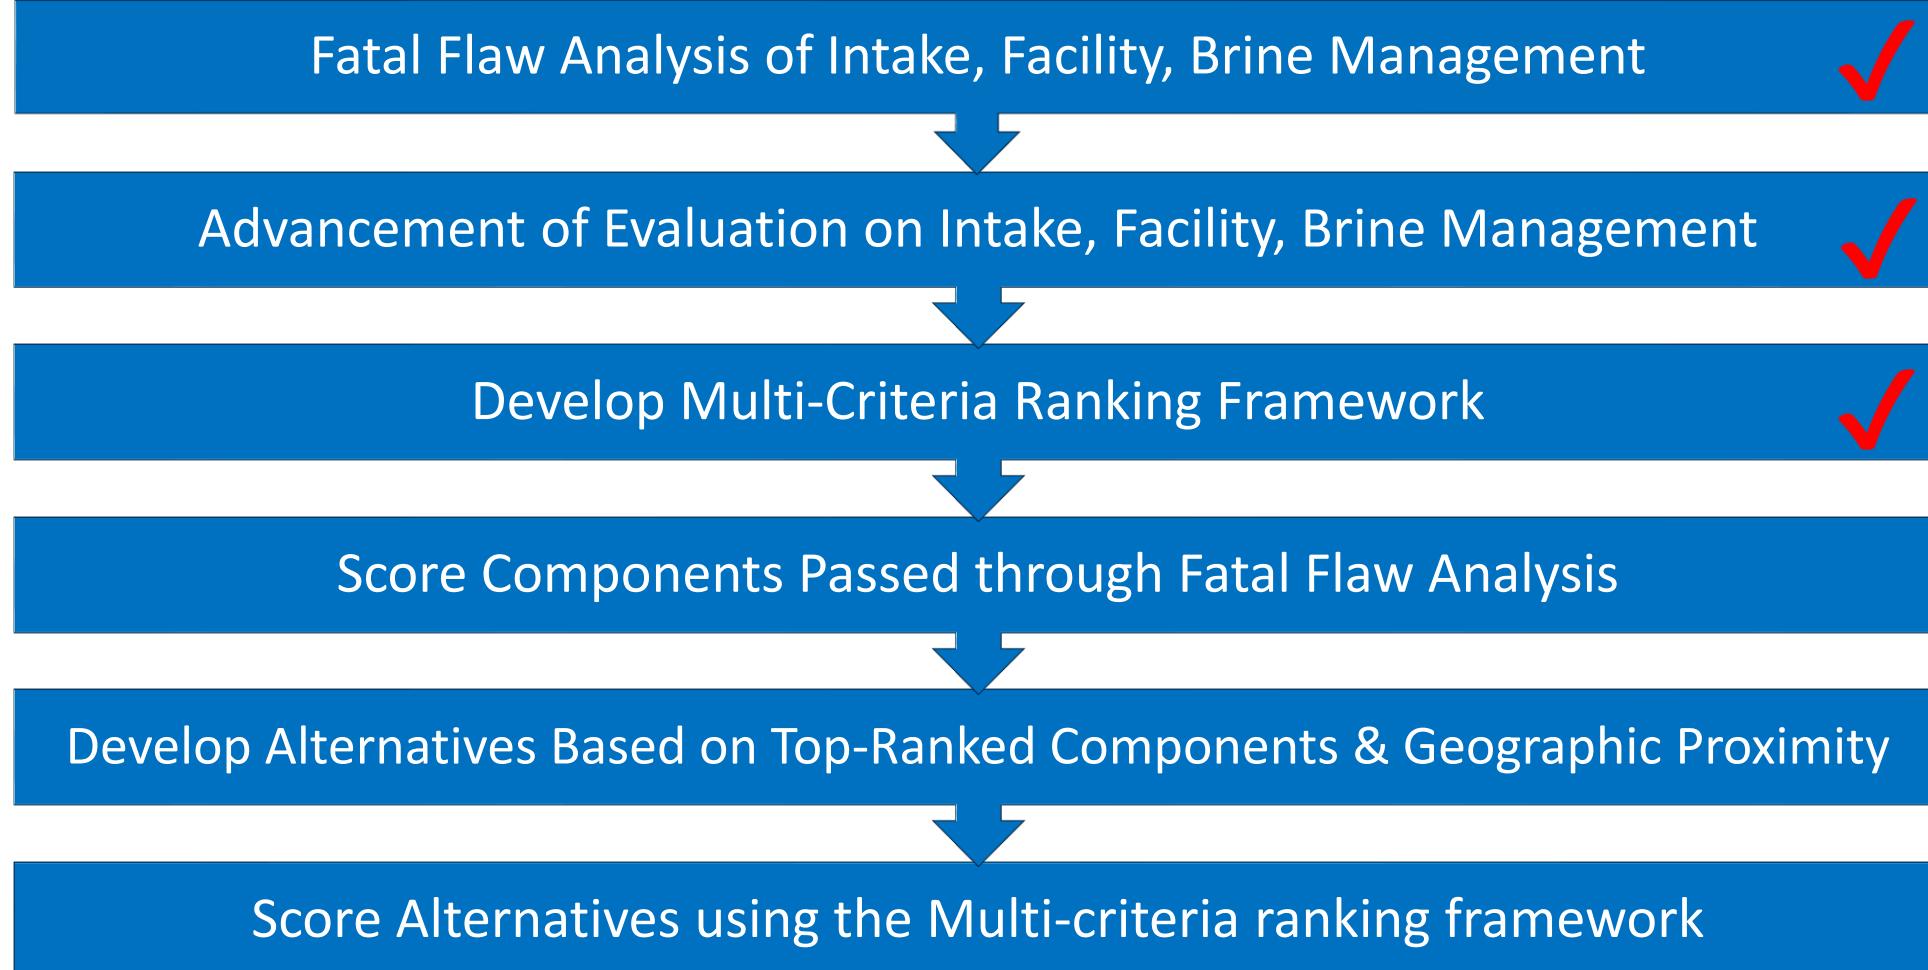

# Alternatives Analysis -Intake Conveyance and Distribution

14

Intake Volumes vs Produced Water at 42% Recovery Rate

Intake Water (MGD)	Produced Water (MGD)
24	10
47	20
95	40




Possible Conveyance to Existing Distribution System


# Alternatives Analysis - Brine Discharge Considerations

15

Huntington Beach Desalination Facility  
Proposed Linear Diffuser

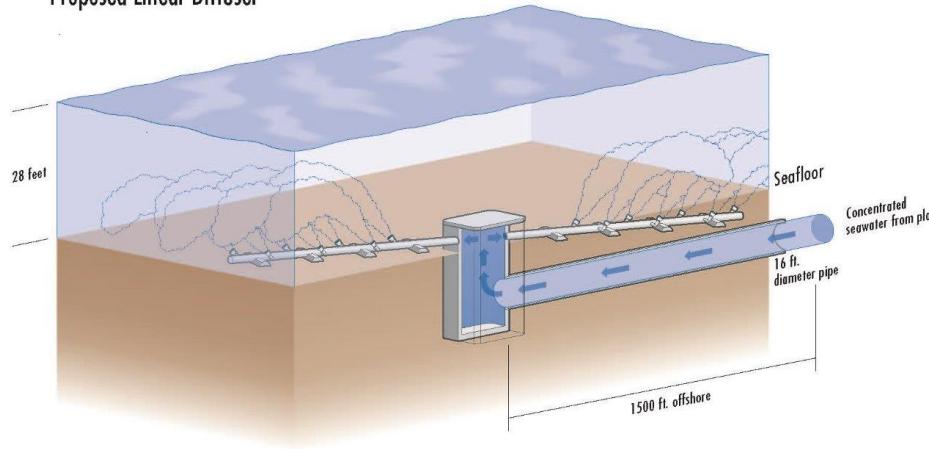



Conceptual Graphic of a Multi-Port Brine Diffuser for a Deepwater Discharge System

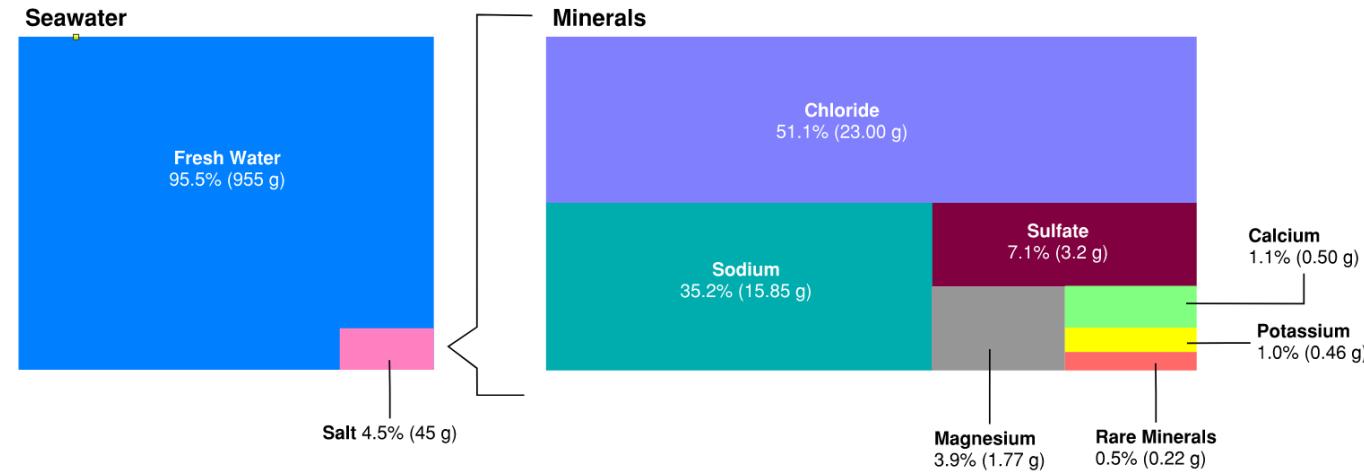

Resource Recovery-Constituents in Seawater

# Alternatives Analysis-Energy Use Considerations

16

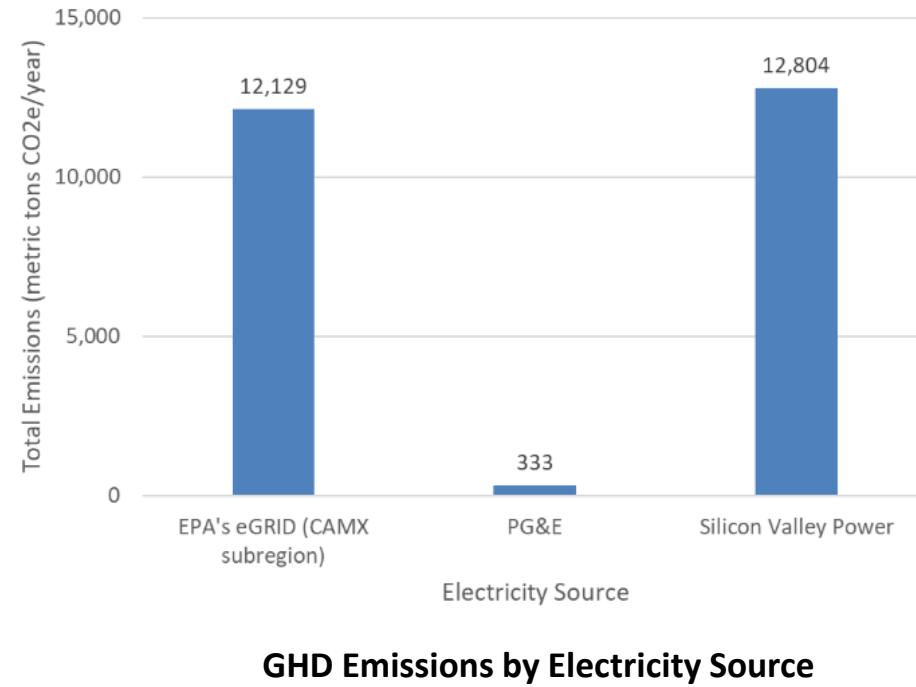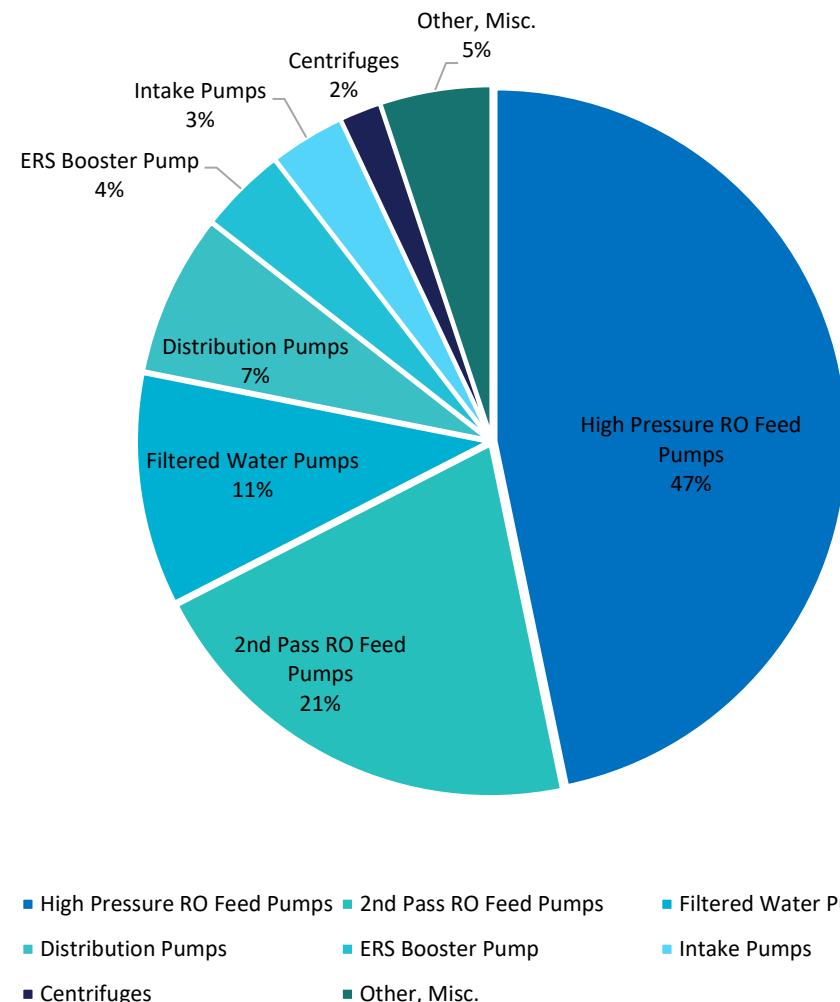


# Next Steps

# Next Steps

- **Complete Alternative Analysis Report.**
- **Plan to meet** with the Recycled Water Committee after completion of Alternative Analysis Report – First Quarter of 2026
- **Plan to engage** with relevant interest groups during development of Alternative Analysis Report – First Quarter of 2026

## Where We Are Today

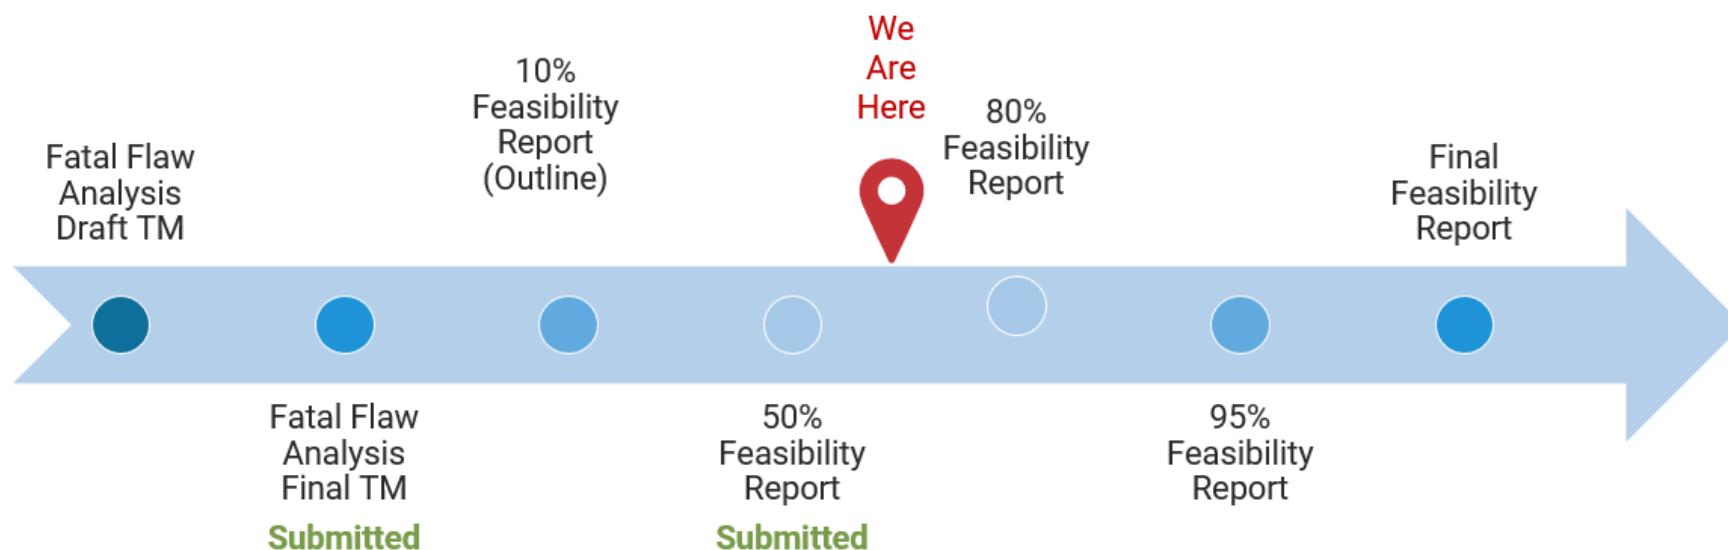

# Thank you!



**Valley Water**

Clean Water • Healthy Environment • Flood Protection



**BLACK & VEATCH**

**THIS PAGE INTENTIONALLY LEFT BLANK**